


TYPICAL DETAIL

1. MINIMUM DIMENSION FROM TOP OF PIPE TO FINISHED GRADE SHALL BE 4 FT.
2. THIS DETAIL IS BASED ON MIN. 2" CA/VRV. PIPE AND FITTINGS TO BE SIZED ACCORDINGLY FOR LARGER VALVE SIZES AND TYPES.
3. PROVIDE SUPPORT AS REQUIRED USING 316 STAINLESS STEEL MOUNTING BRACKET AND HARDWARE

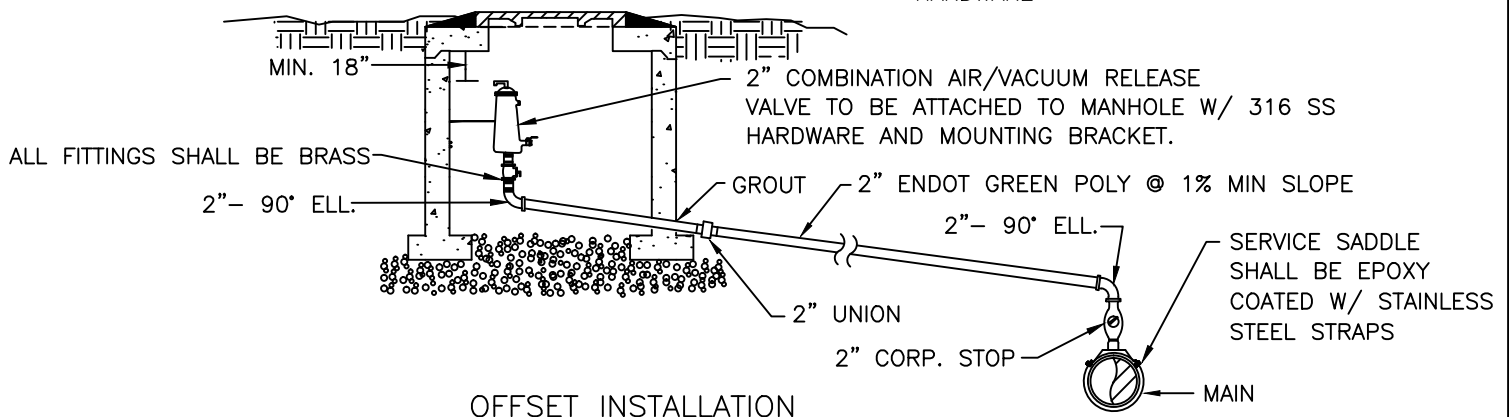

# BELOW GRADE WASTEWATER COMBINATION AIR/VACUUM RELEASE VALVE